

NOTES:


- 1. REFER TO ENGINEERING CODE OF PRACTICE FOR NUMBER OF CONNECTIONS TO A SUBMAIN 7.4.15
- 2. DETECTOR TAPE TO BE INSTALLED 200mm ABOVE ALL PIPE WORK
- 3. ONLY AUTHORISED INSTALLERS AS PER CLAUSE 7.7.1 OF ECP CAN INSTALL WATER
- 4. Ø50 SLUICE VALVES TO BE AVK OR HAWLE OR EQUIVALENT



TYPICAL RING FED WATER MAIN

STANDARD NO: WS 1.0


DATE: JAN 2023 SCALE: NTS

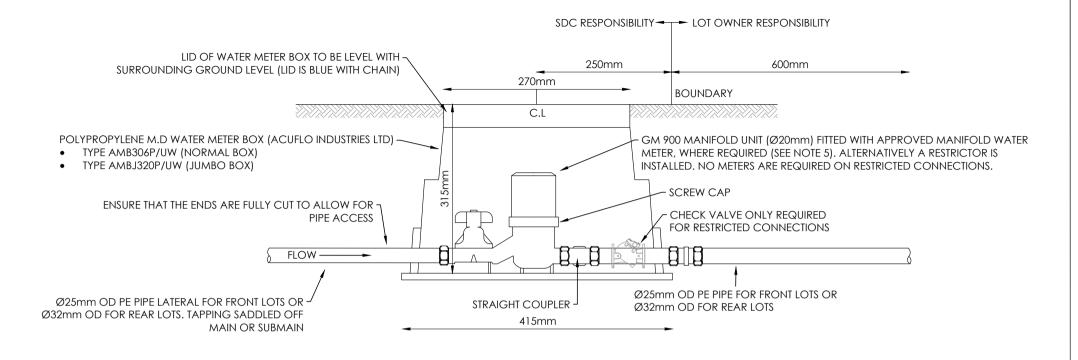

NOTES:

- ONLY FITTINGS AS DETAILED IN THIS DRAWING OR AS APPROVED BY ENGINEER MAY BE USED
- 2. NO PTF TAPE SHALL BE USED WHEN FITTING THE METER TO THE MANIFOLD
- 3. WHEN RESTRICTED SUPPLY IS REQUIRED, THE MARIC INSERT FOR THE REQUIRED FLOW SHALL BE INSTALLED IN THE MANIFOLD AND THE FLOW METER NOT INSTALLED
- 4. ALL RESTRICTED CONNECTIONS REQUIRE A DUAL CHECK VALVE IN PLACE.

 EXTRA NON RETURN VALVE TO BE ATTACHED TO MANIFOLD WHEN A RESTRICTIED CONNECTION IS REQUIRED.
- 5. TRAFFICABLE LIDS REQUIRED IF WATER IS LOCATED IN A VEHICLE CROSSING

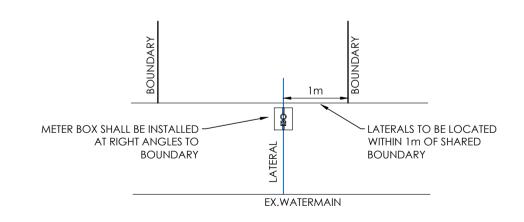




GM - 900 MANIFOLD UNIT

STANDARD NO: WS 2.0

JAN 2023

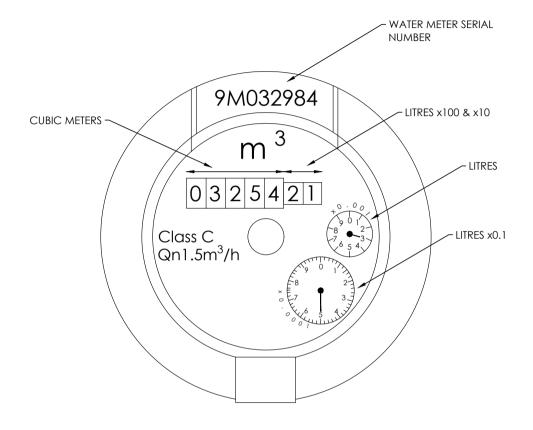


THIS METER READS 3254 CUBIC METERS AND 213.5 LITRES



WATER METER READING

STANDARD NO: WS 2.1

JAN 2023

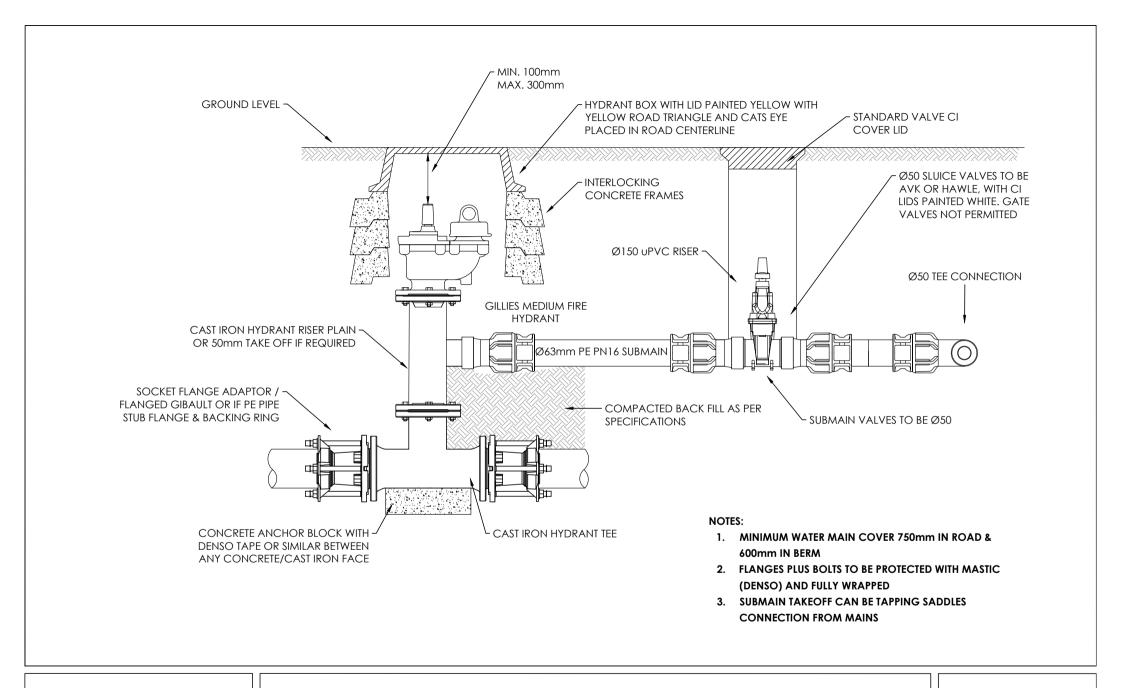




STANDARD FIRE HYDRANT CONNECTIONS

STANDARD NO: WS 3.0

JAN 2023

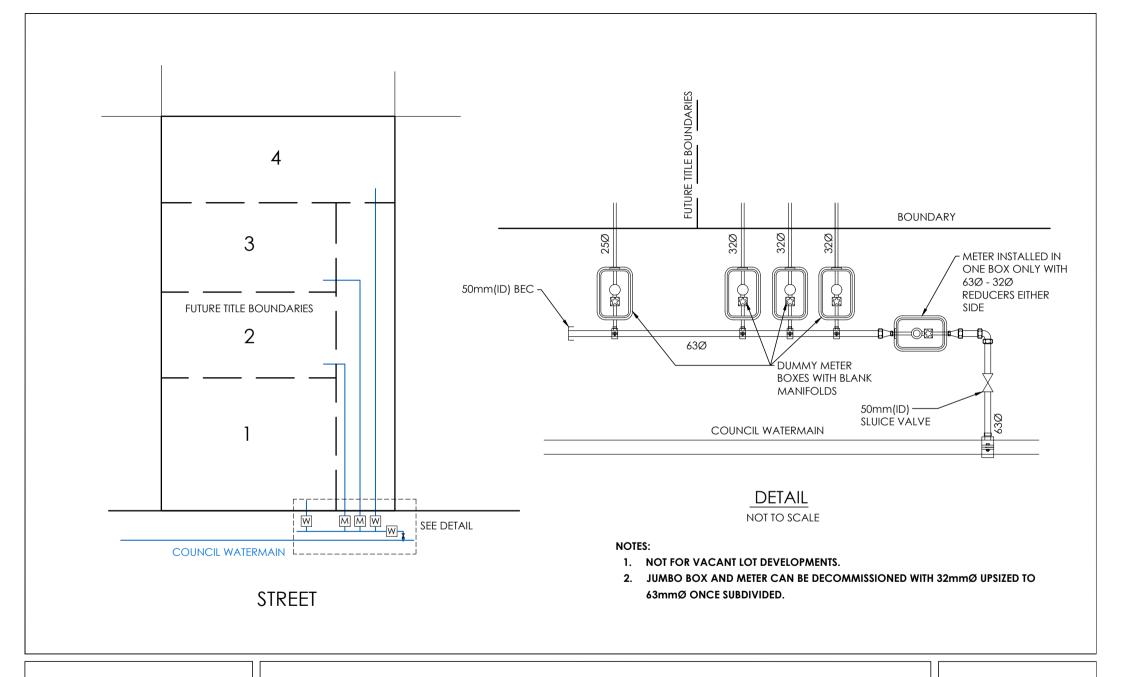




WATER SUPPLY CONNECTIONS TO MUILTI - UNIT RESIDENTIAL DEVELOPMENTS

STANDARD NO: WS 4.0

JAN 2023

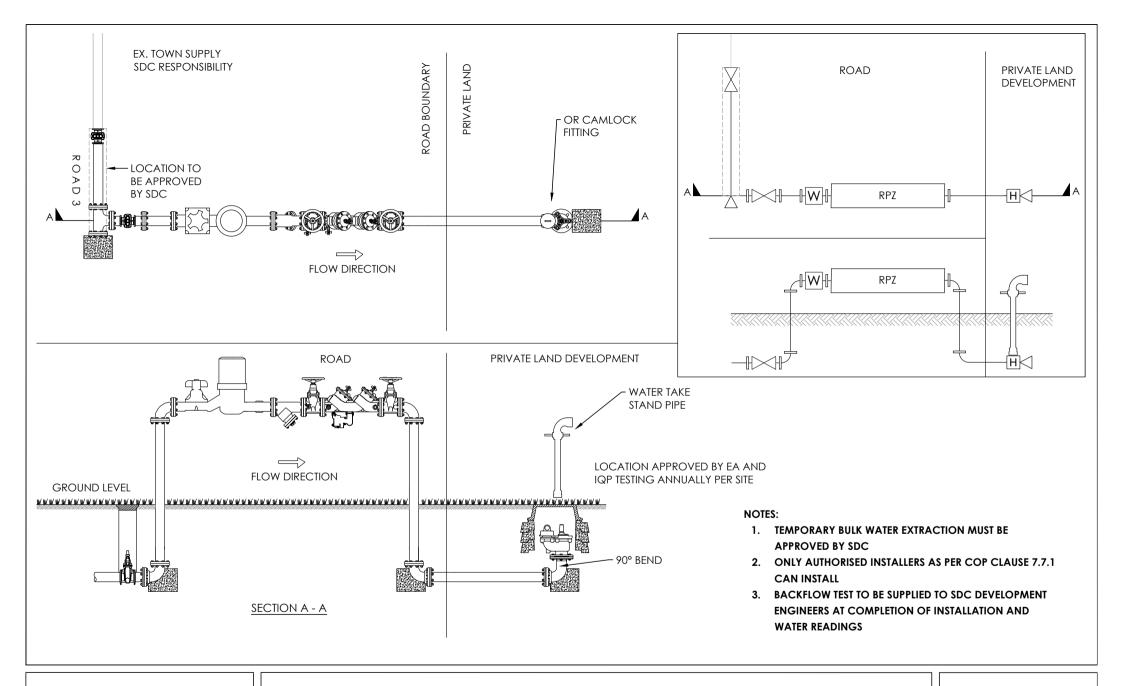




TEMPORARY BULK WATER EXTRACTION STANDARD DETAIL

STANDARD NO: WS 5.0

JAN 2023

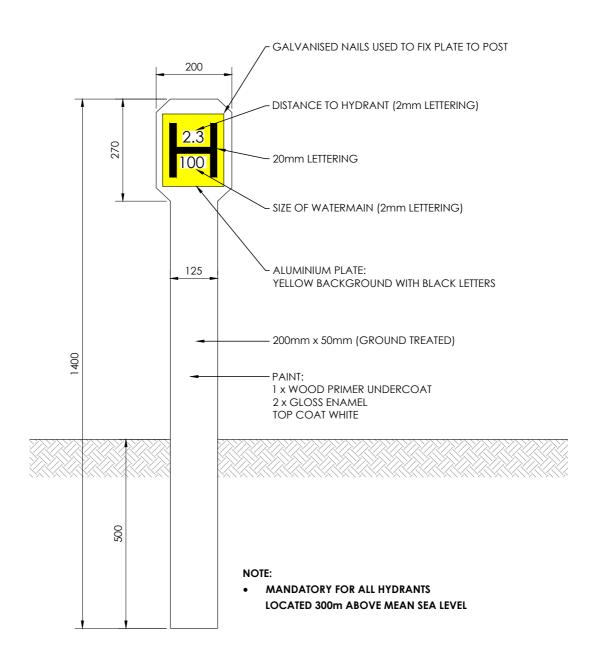



STANDARD FIRE HYDRANT MARKER POST STANDARD NO: WS 6.0 DATE: MARCH 2025

SCALE: 1:10